

Standard Operating Procedure VAL 190

Title: Guideline for the Validation of Aseptic Processing

Diagram 1 – Non-viable particulate monitoring positions for Filling Rooms

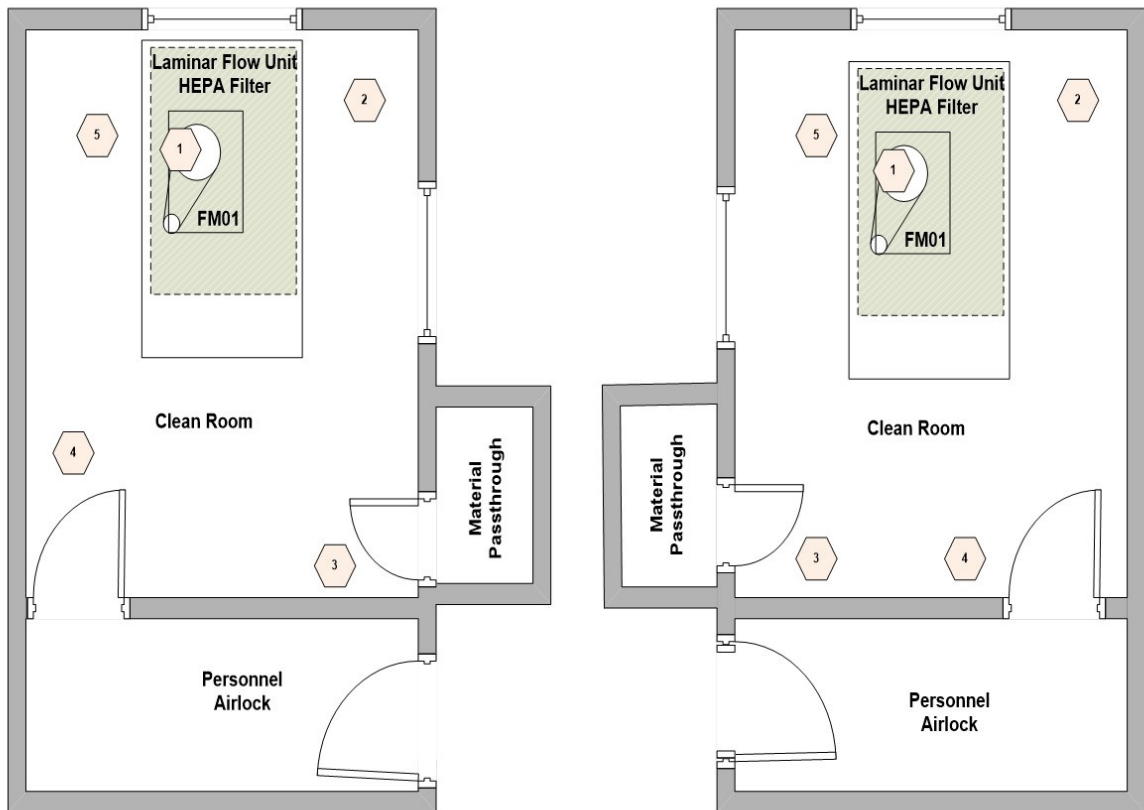


Table 4 – Non-viable particulate monitoring positions and frequency for Filling Rooms

Classification	Location	Location Description	Frequency
Grade A	1	Near the crimping station	6 monthly
Grade B	2	Near the phone	6 monthly
Grade B	3	Near the material pass-through	6 monthly
Grade B	4	Near the entry door	6 monthly
Grade B	5	Near the bottle basket (outside the curtain area)	6 monthly